

**G&W**


Engineered to order. Built to last.

U4-2

1000:1 CT Ratio

Curves correspond to the trip settings in the trip module and are applicable over the entire temperature of the device

— Maximum Clear  
- - - Minimum Trip

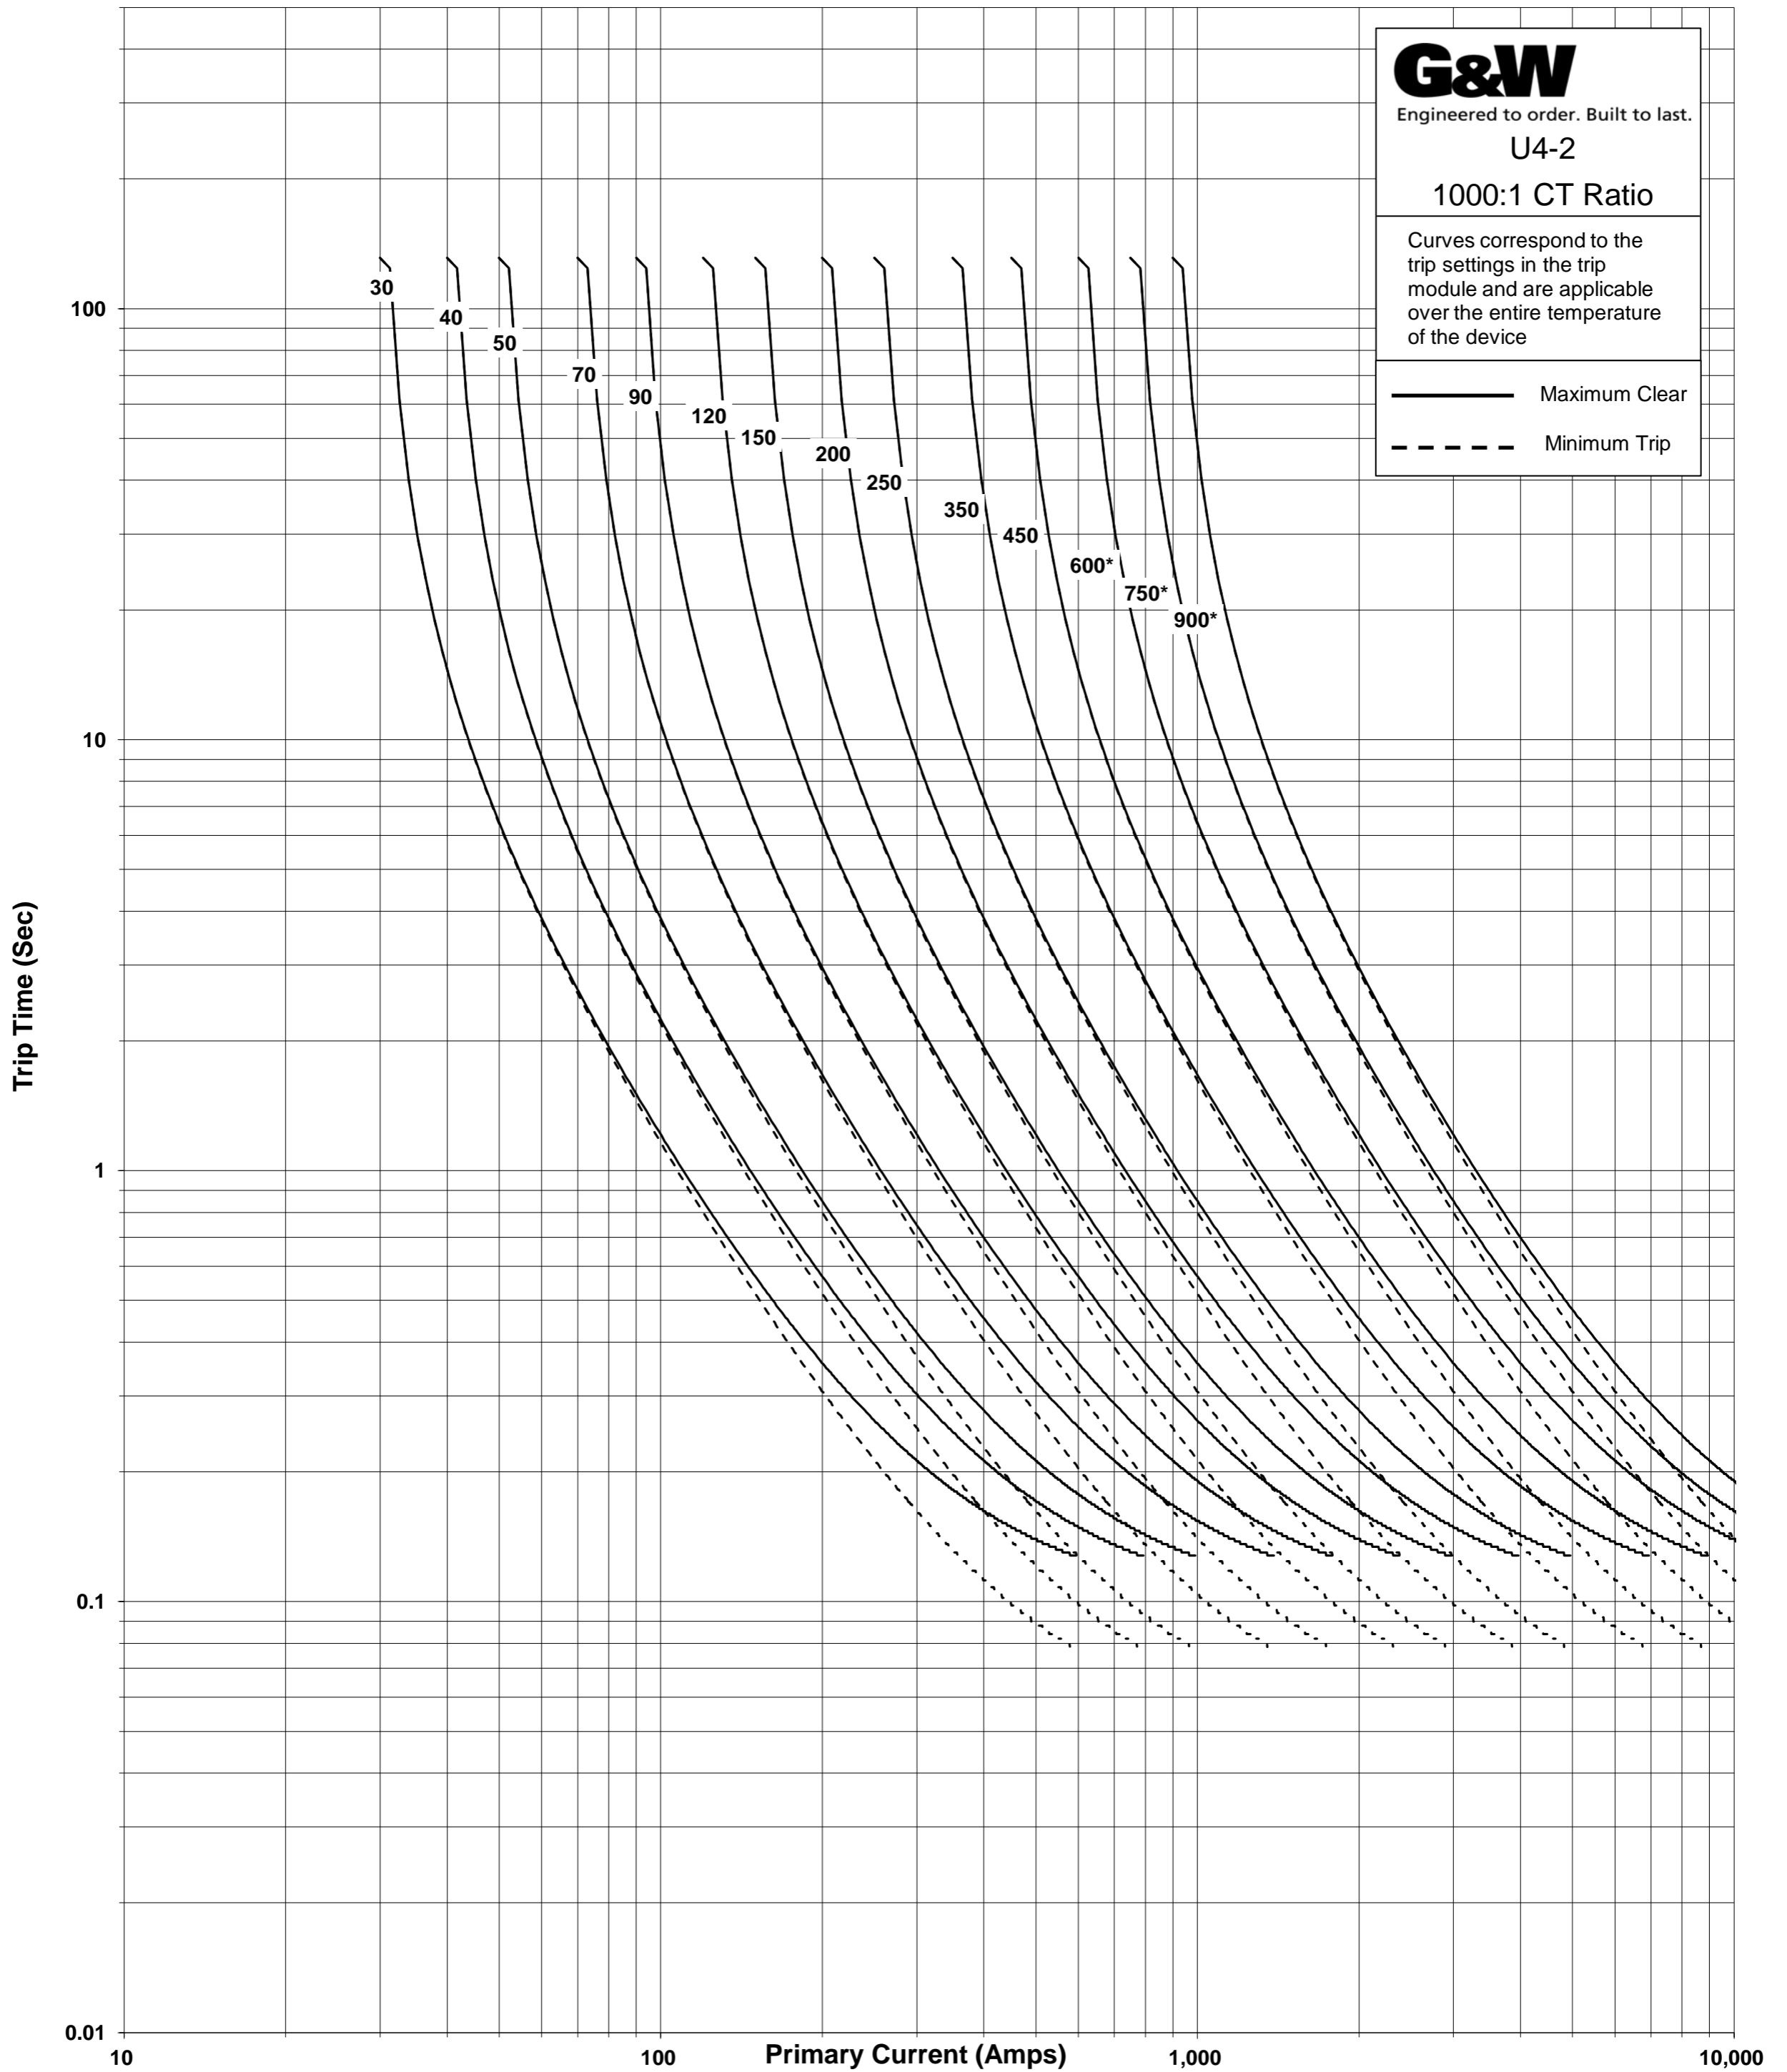

**TIME - CURRENT CHARACTERISTIC CURVES  
FOR VI CONTROLS**

\* For curves that fall out of scaling on this chart, please contact G&W.

Note: This curve is applicable to controls programmed with control software VICSS V2. For more information contact G&W